



F-GS-1


**GENERAL NOTES:**

1. REFER TO APPLICABLE FORTIFIED HOME STANDARDS FOR ADDITIONAL INFORMATION.
2. REFER TO FORTIFIED STANDARD DETAIL F-G-1 FOR CORROSION PROTECTION REQUIREMENTS.
3. **TO MAINTAIN PROPER ATTIC VENTILATION, VENT SHUTTERING MAY BE PERFORMED ON A TEMPORARY BASIS ONLY AND SHUTTERS ARE TO BE REMOVED AFTER A STORM THREAT IS OVER. ADEQUATE ATTIC VENTILATION MUST BE MAINTAINED ON A REGULAR BASIS.**
4. FORTIFIED HOME STANDARDS ARE TO BE APPLIED IN CONJUNCTION WITH FEDERAL, STATE, AND LOCAL CODES, ORDINANCES AND REGULATIONS IN ADDITION TO THE STRUCTURAL DESIGN WHICH IS BY OTHERS. IN CASE OF A CONFLICT BETWEEN PROVISIONS, USE WHICHEVER IS MORE STRINGENT.

WOOD STRUCTURAL PANEL OR OTHER NONPOROUS FLAT SHUTTER CUT TO FIT W/ 7/16" MIN. THICKNESS. PRE-DRILL HOLES AT FASTENER LOCATIONS. SHAPE MAY VARY, BUT NOT TO EXCEED MAX. DIMENSIONS AND FASTENER SPACING SHOWN.

OUTLINE OF GABLE VENT BEYOND SHUTTER

PERMANENT, CORROSION RESISTANT FASTENER THROUGH PRE-DRILLED HOLES. REFER TO TABLE F-GS-1 FOR FASTENER INFORMATION. MINIMUM OF (2) FASTENERS PER EACH PANEL SIDE REQUIRED.

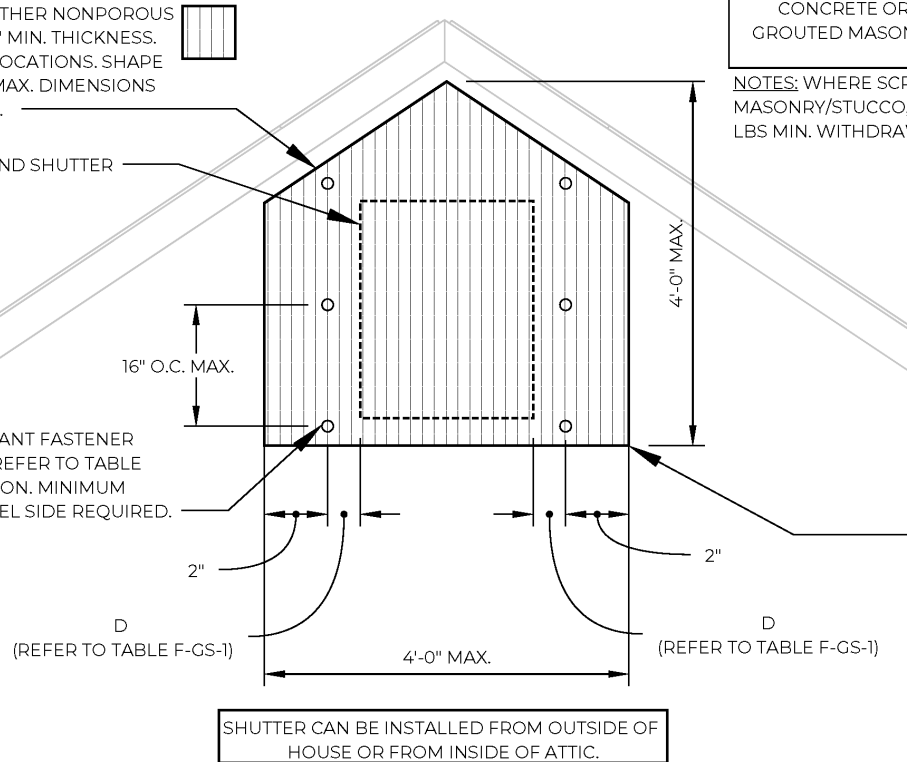

SHUTTER CAN BE INSTALLED FROM OUTSIDE OF HOUSE OR FROM INSIDE OF ATTIC.

**TABLE F-GS-1: FASTENING SCHEDULE FOR GABLE VENT COVER.**

SUPPORT STRUCTURE TYPE	FASTENER TYPE & SIZE	END DISTANCE, D
WOOD	1/4" Ø LAG SCREWS W/ 2" EMBEDMENT & 1" Ø WASHER	1"
CONCRETE OR GROUTED MASONRY	1/4" Ø FASTENER W/ 2" EMBEDMENT & 1" Ø WASHER	1.5"

NOTES: WHERE SCREWS ARE ATTACHED TO MASONRY OR MASONRY/STUCCO, USE VIBRATION-RESISTANT ANCHORS W/ 1500 LBS MIN. WITHDRAWAL CAPACITY.

NOTE: SELF-ADHESIVE WEATHER STRIPPING CAN BE USED TO SEAL THE SHUTTERS TO THE TRIM BOARDS AROUND VENT EDGES. IF SHUTTER IS INSTALLED ON INSIDE OF ATTIC, ENSURE THAT ANY WATER THAT ACCUMULATES IN THE CAVITY CAN DRAIN TO THE OUTSIDE OF THE HOUSE AND NOT INTO THE WALL BELOW.

	<p><b>APPLICABLE STANDARDS:</b></p> <p>FORTIFIED HOME™ - HURRICANE (2020)</p>	<p><b>DESCRIPTION:</b></p> <p>TEMPORARY GABLE VENT SHUTTERING</p>	<p><b>DRAWING #:</b></p> <p>F-GS-1</p>
			<p><b>DATE:</b> 11/01/2020</p>